
 Specifications NIPPON VALVE CONTROLS, INC.	"EI" (Standard Optional Code) 4~20mA Isolated signal board	No. SPC-OPEI-EN Created by Ogata 2016/12/12
--	---	---

Specifications

Type	"EI" (Standard Optional Code)	
Name	4~20mA Isolated signal board	
Classification	The optional board for PBX, PHX, PDX, AEX, PEX series.	
Feature	EI option board's output indication signal is from 4~20mA. It is isolated from the input signal. The board is installed in the electric actuator for the PBX, PDX, PHX, AEX, PEX series.	
Output signal	4~20mA less than 600Ω	
Adjustment	ZERO or SPAN trimmer on positioner board.	
Note	PBX, PHX, PDX	"+/-" terminal (indication signal) on the positioner board is unavailable.
	AEX, PEX	4~20mA isolation signal is output from the "+/-" terminal on the positioner board.

Wiring

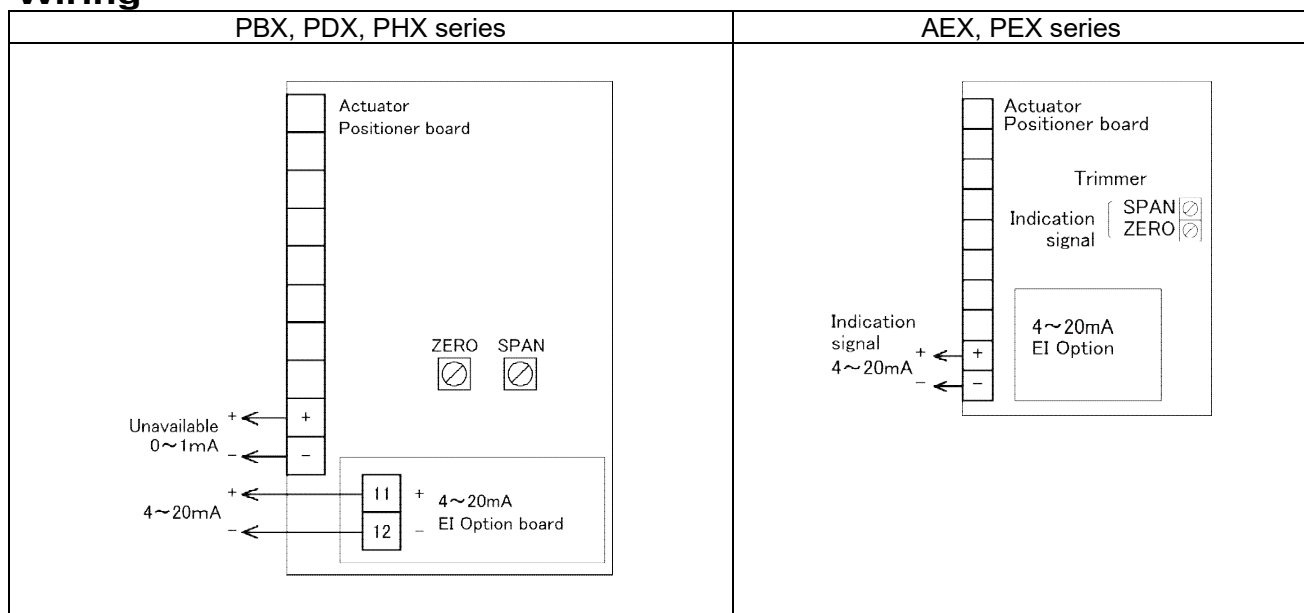

Note

Product code - - EI

| | | |

① ② ③ ④ ⑤ ⑥ ⑦ ⑧

①Actuator type ②Valve type ③Voltage ④Sizing code ⑤Connection ⑥Materials ⑦Valve DN ⑧Option