

Please read this document before using these valves.

GENERAL

Threaded-end ball valve and compact electric actuator.

Actuator

AM : For AC power.

AH1 : For AC power.
(High speed)

DM : For DC power.

PAX : Proportional control.

ACR : Emergency Shut Off.

Valve

AE type Long neck.

E type For general use.

EG type For high temp. (up to 1 MPa)

SR type For food / Corrosive fluid.

SH type For high temp. (up to 2 MPa)

MS type 3 piece / For heavy load.

MV type 3 piece / For control.


TE type Long neck.

EL type For general use.

TV type For diversion flow and mixing.

ST type 4 seats, 3 way. (with flow paths)

SL type 4 seats, 3 way.

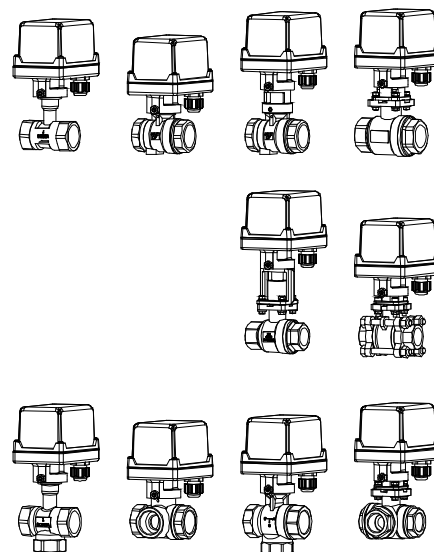

PRODUCT CODE

AE type		<div><div></div><div></div><div></div></div>	A E	<div><div></div><div></div></div>	5	T	T	P	-	<div><div></div><div></div><div></div></div>	-	<div><div></div><div></div></div>	-	<div><div></div><div></div></div>
E type	(Stainless)	<div><div></div><div></div><div></div></div>	E -	<div><div></div><div></div></div>	5	Y	Y	F	-	<div><div></div><div></div><div></div></div>	-	<div><div></div><div></div></div>	-	<div><div></div><div></div></div>
	(Brass)	<div><div></div><div></div><div></div></div>	E -	<div><div></div><div></div></div>	5	U	U	T	-	<div><div></div><div></div><div></div></div>	-	<div><div></div><div></div></div>	-	<div><div></div><div></div></div>
EG type		<div><div></div><div></div><div></div></div>	E G	<div><div></div><div></div></div>	5	U	U	P	-	<div><div></div><div></div><div></div></div>	-	<div><div></div><div></div></div>	-	<div><div></div><div></div></div>
SR type		<div><div></div><div></div><div></div></div>	S R	<div><div></div><div></div></div>	5	U	U	T	-	<div><div></div><div></div><div></div></div>	-	<div><div></div><div></div></div>		
SH type		<div><div></div><div></div><div></div></div>	S H	<div><div></div><div></div></div>	5	U	U	F	-	<div><div></div><div></div><div></div></div>	-	<div><div></div><div></div></div>		
MS type		<div><div></div><div></div><div></div></div>	M S	<div><div></div><div></div></div>	5	U	U	P	-	<div><div></div><div></div><div></div></div>	-	<div><div></div><div></div></div>		
MV type		<div><div></div><div></div><div></div></div>	M V	<div><div></div><div></div></div>	5	U	U	P	-	<div><div></div><div></div><div></div></div>	-	<div><div></div><div></div></div>	-	<div><div></div><div></div></div>
	(Standard port)	<div><div></div><div></div><div></div></div>	M V	<div><div></div><div></div></div>	5	U	U	P R		<div><div></div><div></div><div></div></div>	-	<div><div></div><div></div></div>	-	<div><div></div><div></div></div>
TE type		<div><div></div><div></div><div></div></div>	T E	<div><div></div><div></div></div>	5	T	T	P	-	<div><div></div><div></div><div></div></div>	-	<div><div></div><div></div></div>	-	<div><div></div><div></div></div>
EL type		<div><div></div><div></div><div></div></div>	E L	<div><div></div><div></div></div>	5	U	U	T	-	<div><div></div><div></div><div></div></div>	-	<div><div></div><div></div></div>		
TV type		<div><div></div><div></div><div></div></div>	T V	<div><div></div><div></div></div>	5	T	T	P	-	<div><div></div><div></div><div></div></div>	-	<div><div></div><div></div></div>	-	<div><div></div><div></div></div>
ST type		<div><div></div><div></div><div></div></div>	S T	<div><div></div><div></div></div>	5	U	U	F	-	<div><div></div><div></div><div></div></div>	-	<div><div></div><div></div></div>		<div><div></div><div></div></div>
SL type		<div><div></div><div></div><div></div></div>	S L	<div><div></div><div></div></div>	5	U	U	F	-	<div><div></div><div></div><div></div></div>	-	<div><div></div><div></div></div>		
		(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	

(1) Actuator
AM1 AM2 AH1
DM0 DM2 PAX ACR

(2) Valve
AE E- EG SR SH
MS MV
TE EL TV ST SL

(3) Voltage
1 : 100 / 110 V AC
2 : 200 / 220 V AC
2 : 100 to 220 V AC (ACR)
0 : 24V DC

(4) Sizing code
0 : Standard
1 : Light
2 : Heavy

(5) Connection
5 : Threaded
End Rc

(6) Body material
T : SCS13A
Y : C3771BE
U : SCS14A

(7) Ball material
T : SCS13A / SUS304
Y : C3771BE / C3604BD
U : SCS14A / SUS316

(8) Seat material
P : R-PTFE
F : F-PTFE
T : PTFE








(9) Size [mm]
ex. 25 A → 025

(10) Option
AK : Aluminum alloy
motor cover
M1 : Manual lever
C1 : Flexible cable














(11) Operation mode (PAX)
Nil : Mode A
J : Mode B

(12) Flow paths (ST)
a to d : 3 way valve flow

VALVES SPECIFICATIONS


 Water
  Oil
  Air, Gas
  Steam
  Chemicals
  Sea water
  Slurry
  Negative pressure

AE E EG type

Valve type	AE	E (Brass)		E (Stainless)			EG
Design	2 way, Reduced port	2 way, Standard port		2 way, Standard port			2 way, Standard port
Connection	Threaded End Rc	Threaded End Rc		Threaded End Rc			Threaded End Rc
Fluid	   	  		  			  
Max pressure	1 MPa	1 MPa		2 MPa	1 MPa		1 MPa
Size [mm]	015 to 025	015 to 025	032 to 050	008 to 010	015	020 to 050	015 to 050
Material	Body	SCS13A		C3771BE (Plated)			SCS14A
	Ball	SUS304		C3604BD (Plated)	C3771BE (Plated)	SUS316	SCS14A
	Seat	R-PTFE		F-PTFE		PTFE	R-PTFE
Stem seal	Packing	PTFE		-			-
	O-ring	FKM		FKM			Steam resistant FKM

PRESSURE & TEMPERATURE RATING


AE

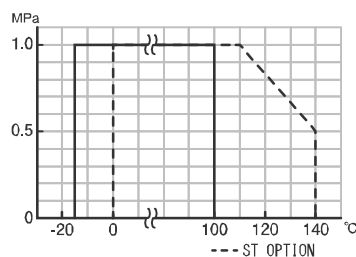


The optional for steam fluids.

Valve type	Option code	O-ring
AE	ST	Replace (Steam resistant FKM)


E (Brass)

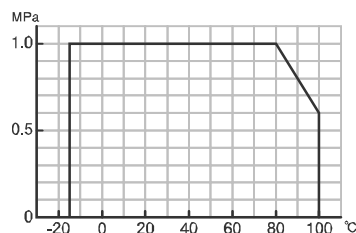

E (Stainless)

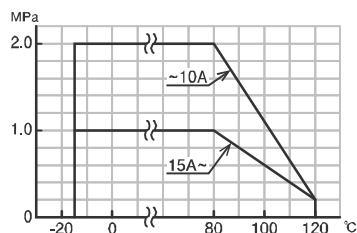


EG

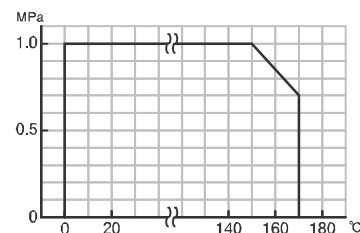


INHERENT FLOW CHARACTERISTIC

AE

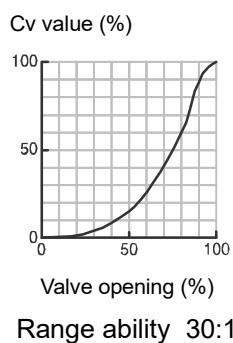



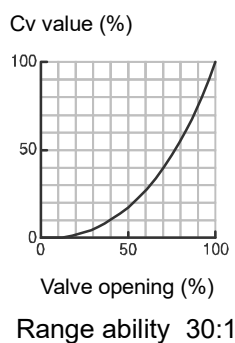




E EG




VALVES SPECIFICATIONS

Water Oil Air, Gas Steam Chemicals Sea water Slurry Negative pressure





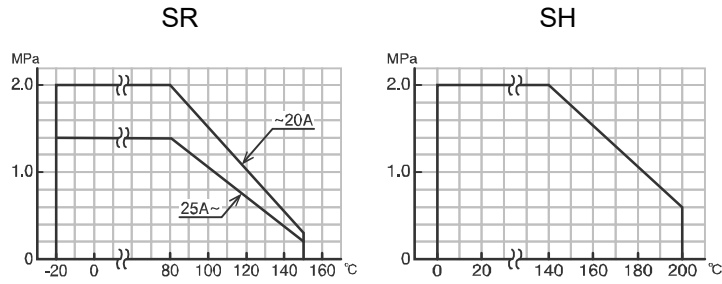



SR SH type

Valve type		SR		SH
Design		2-way, Full port		2-way, Full port
Connection		Threaded End Rc		Threaded End Rc
Fluid		   		  
Max pressure		2 MPa	1.4 MPa	2 MPa
Size [mm]		015 to 020	025 to 040	015 to 032
Material	Body	SCS14A		SCS14A
	Ball	SCS14A		SCS14A
	Seat	PTFE		F-PTFE
Stem seal	Packing	F-PTFE		R-PTFE
	O-ring	-		Steam resistant FKM








PRESSURE & TEMPERATURE RATING





VALVES SPECIFICATIONS

 Water
  Oil
  Air, Gas
  Steam
  Chemicals
  Sea water
  Slurry
  Negative pressure

MS MV type

Valve type		MS	MV		
Design		2-way, Full port	2-way, V-port		
Connection		Threaded End Rc	Threaded End Rc		
Fluid		   	  		
Max pressure		3.5 MPa	2 MPa		
Size [mm]		010 to 025	R010 to R015	015	020 to 025
Material	Body	SCS14A	SCS14A		
	Ball	SCS14A	SUS316		SCS14A
	Seat	R-PTFE	R-PTFE		
Stem seal	Packing	R-PTFE	R-PTFE		
	O-ring	FKM	FKM		

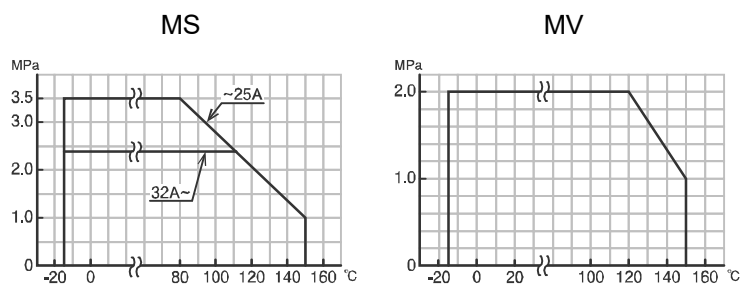






PRESSURE & TEMPERATURE RATING**INHERENT FLOW CHARACTERISTIC (MV)**

Range ability











MV-5UUP R 010 to 015 100:1

MV-5UUP - 015 to 025 50:1

VALVES SPECIFICATIONS



 Water
  Oil
  Air, Gas
  Steam
  Chemicals
  Sea water
  Slurry
  Negative pressure





TE EL TV type

Valve type		TE	EL		TV	
Design		3 way, Reduced port	3 way, Standard port		3 way, Standard port	
Connection		Threaded End Rc	Threaded End Rc		Threaded End Rc	
Fluid		   	  		  	
Max pressure		1 MPa	1 MPa		1 MPa	
Size [mm]		015 to 025	008 to 015	020 to 050	015 to 025	032 to 040
Material	Body	SCS13A	SCS14A		SCS13A	
	Ball	SUS304	SUS316	SCS14A	SUS304	SCS13A
	Seat	R-PTFE	PTFE		R-PTFE	
Stem seal	Packing	PTFE	-		-	
	O-ring	FKM	FKM		FKM	

The optional for steam fluids.

Valve type	Option code	O-ring
TE	ST	Replace (Steam resistant FKM)

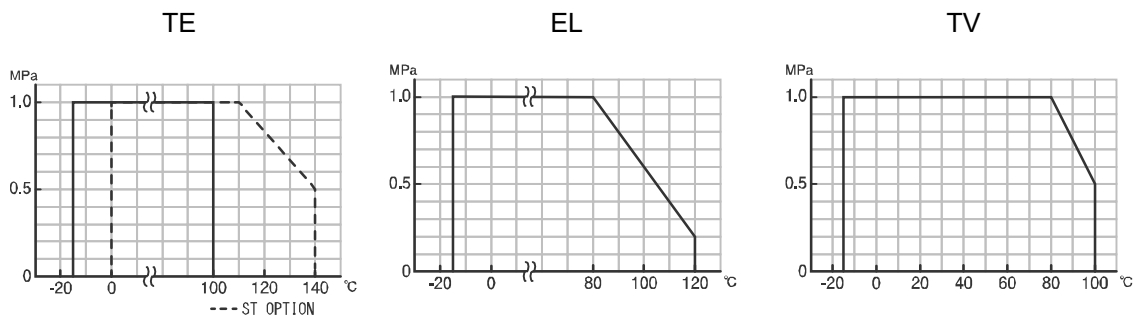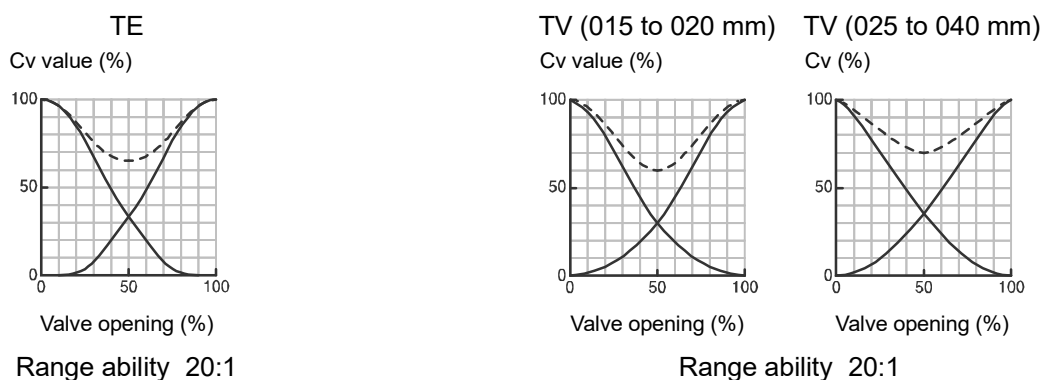PRESSURE & TEMPERATURE RATING**INHERENT FLOW CHARACTERISTIC****FLOW PATHS (Position① / P1) (Position② / P2)**





TE	EL TV
 	 

Note) When a closed path is exposed to high pressure, it may leak slightly to an open path.


VALVES SPECIFICATIONS

 Water  Oil  Air, Gas  Steam  Chemicals  Sea water  Slurry  Negative pressure











ST SL type

Valve type		ST SL
Design		3 way, Standard port
Connection		Threaded End Rc
Fluid		   
Max pressure		1 MPa
Size [mm]		015 to 032
Material	Body	SCS14A
	Ball	SCS14A
	Seat	F-PTFE
Stem seal	Packing	F-PTFE

PRESSURE & TEMPERATURE RATING

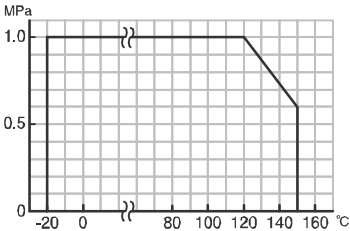

FLOW PATHS (Position① / P1) (Position② / P2)

ST				SL
Code: a	Code: b	Code: c	Code: d	
  A-B ⇔ B-C	  A-C ⇔ A-B	  B-C ⇔ A-B-C	  A-B-C ⇔ A-C	  B-C ⇔ A-C


Note) When a closed path is exposed to high pressure, it may leak slightly to an open path.

ELECTRIC ACTUATOR SPECIFICATIONS


3 way valve: SHUT / Position①, OPEN / Position②

AM1 AM2 type

Actuator type (□:Voltage code)	AM1-030-□	AM1-070-□	AM1-180-□	AM2-030-□	AM2-070-□	AM2-180-□
Voltage	100 / 110 V AC ±10 % 50/60 Hz (Voltage code: 1) 200 / 220 V AC ±10 % 50/60 Hz (Voltage code: 2)					
Rated torque [N·m]	3	7	18	3	7	18
Operation time [s]	5.4 / 4.5 (50/60 Hz)	15.5 / 13 (50/60 Hz)	16 / 13.5 (50/60 Hz)	5.4 / 4.5 (50/60 Hz)	15.5 / 13 (50/60 Hz)	16 / 13.5 (50/60 Hz)
Power consumption [VA]	16		19	18		19
Motor	Synchronous motor					
Overload protection	Thermal protector					
Method of operation	Transfer input type			a-contactinput type, with built-in relay		
Operation	Power to S → SHUT (SHUT PL is lit.) Power to O → OPEN (OPEN PL is lit.)			SW is OFF → SHUT (SHUT signal is output.) SW is ON → OPEN (OPEN signal is output.)		
Input signal current	Nil			9 mA (O-terminal) Leakage current in SW: less than 1 mA		
Output signal rating	Resistance load 3 A 250 V AC (Minimum 0.1 A)			Resistance load 0.5 A 125 V AC 2 A 30 V DC Micro load 1 mA 5 V DC		
Duty cycle	20 % 15 min.					
Ambient temperature	-20 to 55 °C					
Space heater	1 W					
Manual operation	Direct operation of actuator by loosening lock screw					
Enclosure	Equivalent to IP65 (IEC 60529)					
Housing material	Aluminum alloy die cast + Polycarbonate resin cover					
Terminal block	For bare wire 0.14 to 1.5 mm² (AWG 26 to 14) Ground terminal: M4					
Conduct port	G3/8 Cable gland (for Φ5 to 10.5 mm cable)					

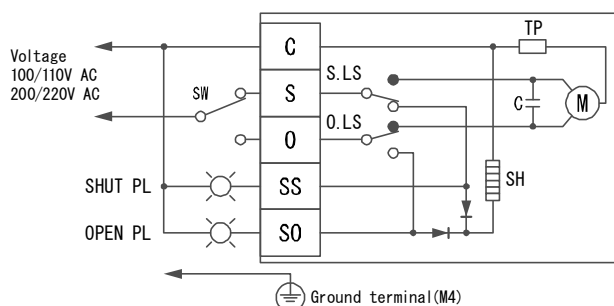WIRING**AM1**

- Control switch should be prepared one by one for actuator. Do not operate two or more actuator from one switch. It might malfunction.

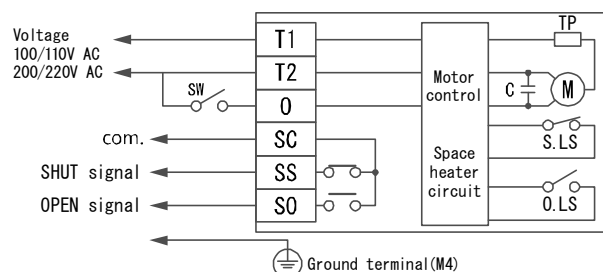AM2


- Two or more actuators can be operated with one control switch.
- When using control switch with current leakage (more than 1 mA) such as TRIAC or relay with CR, it can cause malfunction.

ELECTRIC ACTUATOR SPECIFICATIONS

3 way valve: SHUT / Position①, OPEN / Position②

AH1 type

Actuator type (□:Voltage code)	AH1-030-□		AH1-070-□	AH1-180-□
Voltage	100 / 110 V AC ±10 % 50/60 Hz (Code: 1) 200 / 220 V AC ±10 % 50/60 Hz (Code: 2)			
Rated torque [N·m]	3		7	18
Operation time [s]	3 / 2.5 (50/60 Hz)			6 / 5 (50/60 Hz)
Power consumption [VA]	19		50	
Motor	Synchronous motor		Reversible motor	
Overload protection	Thermal protector			
Method of operation	Transfer input type			
Operation	Power to S → SHUT (SHUT PL is lit.) Power to O → OPEN (OPEN PL is lit.)			
Output signal rating	Resistance load 3 A 250 V AC (Minimum 0.1 A)			
Duty cycle	20 % 15 min.			
Ambient temperature	-20 to 55 °C			
Space heater	0.5 W		1 W	
Manual operation	Direct operation of output shaft			
Enclosure	Equivalent to IP65 (IEC 60529)			
Housing material	Aluminum alloy die cast + Polycarbonate resin cover			
Terminal block	For bare wire 0.14 to 1.5 mm² (AWG 26 to 14) Ground terminal: M4			
Conduct port	G3/8 Cable gland (for Φ5 to 10.5 mm cable)			

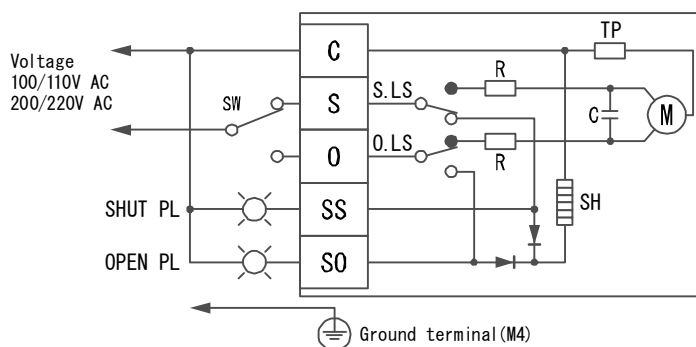WIRING


Note) Control switch should be prepared one by one for actuator.
Do not operate two or more actuator from one switch. It might malfunction.

3 way valve: SHUT / Position①, OPEN / Position②

DM0	DM2	type
-----	-----	------

Actuator type	DM0-030-0	DM0-070-0	DM0-180-0	DM2-030-0	DM2-070-0	DM2-180-0
Voltage	24 V DC					
Rated torque [N·m]	3	7	18	3	7	18
Operation time [s]	0.8 to 1.5	2 to 3	4 to 6	2 to 3.5	2 to 3	4 to 6
Power consumption (Max) [VA]	24			10	24	
Motor	DC motor					
Overload protection	Thermistor					
Method of operation	Switching polarity type			a-contactinput type, with built-in relay		
Operation	<div><div><div>2</div><div>+</div><div>3</div><div>-</div><div>→ SHUT (SHUT PL is lit.)</div></div><div><div>3</div><div>+</div><div>2</div><div>-</div><div>→ OPEN (OPEN PL is lit.)</div></div></div>			<div>SW is OFF → SHUT (SHUT PL is lit.)</div> <div>SW is ON → OPEN (OPEN PL is lit.)</div>		
Input signal current	Nil			16.2 mA (O-terminal)		
Output signal rating	Resistance load 2 A 30 A DC Micro load 1 mA 5 V DC			Resistance load : Less than 1 A 24 V DC		
Duty cycle	20 % 15 min.					
Ambient temperature	-20 to 55 °C					
Space heater	1 W					
Manual operation	Direct operation of output shaft					
Enclosure	Equivalent to IP65 (IEC 60529)					
Housing material	Aluminum alloy die cast + Polycarbonate resin cover					
Terminal block	For bare wire 0.14 to 1.5 mm² (AWG 26 to 16)					
Conduct port	G3/8 Cable gland (for Φ5 to 10.5 mm cable)					

WIRING

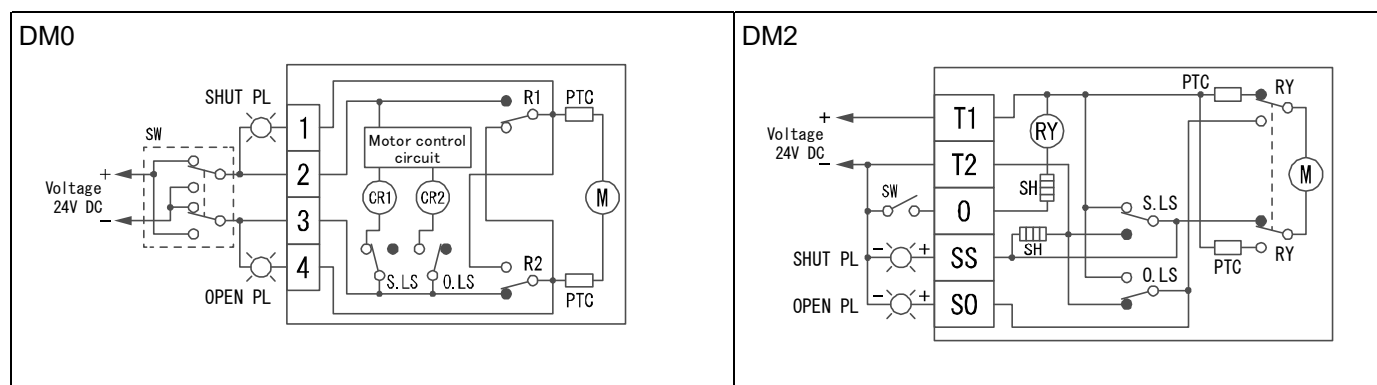

ELECTRIC ACTUATOR SPECIFICATIONS


3 way valve: SHUT / Position①, OPEN / Position②

OPTIONAL PARTS


Specifications	Code No.	AM	AH1	DM	Remarks
Aluminum alloy motor cover	AK	○	○	○	
Manual lever	M1		○	○	Detachable lever
Flexible cable (Approx. 300 mm long)	C1	○	○	○	

DIMENSIONS


AM (030 / 070) DM2 (030)

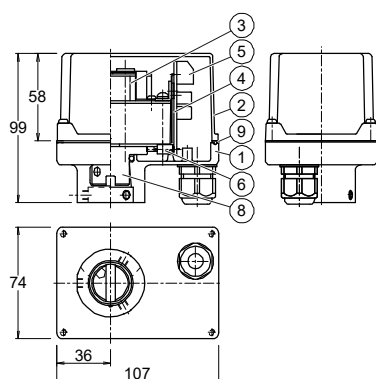

DM0 (030) DM (070) AH1 (030 / 070)

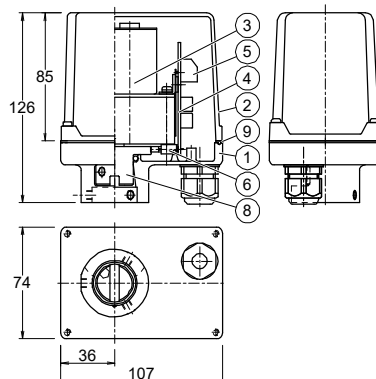

AM (180) DM (180) AH1 (180)

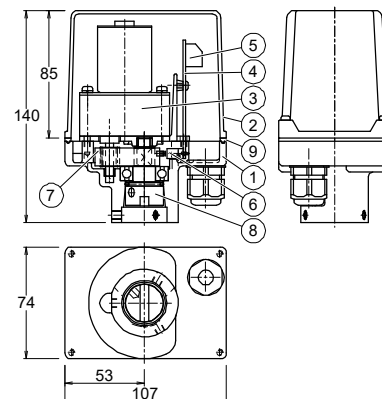**Parts name**

1	Body	4	Control board	7	Drive gear
2	Motor cover	5	Terminal block	8	Drive shaft
3	Motor	6	Limit switch	9	Rubber packing

ELECTRIC ACTUATOR SPECIFICATIONS

3 way valve: SHUT / Position①, OPEN / Position②

PAX type

Actuator type (□:Voltage code)	PAX-050-□	PAX-120-□
Voltage	100 / 110 V AC $\pm 10\%$ 50/60 Hz (Code: 1) 200 / 220 V AC $\pm 10\%$ 50/60 Hz (Code: 2)	
Rated torque [N·m]	5	12
Operation time [s]	14 / 12 (50/60 Hz)	30 / 25 (50/60 Hz)
Power consumption [VA]	9.5	
Motor	Synchronous motor (Triac control)	
Overload protection	Impedance protect	
Method of operation	Proportional control	
Input signal	4 to 20 mA / 1 to 5 V (Input resistance: 250 Ω)	
Operation *1	[Mode A] SHUT by decreased signal \leftrightarrow OPEN by increased signal (Standard) [Mode B] SHUT by increased signal \leftrightarrow OPEN by decreased signal (Option: J)	
Indication signal	0 mA : SHUT \leftrightarrow 1 mA : OPEN (External load resistance: less than 3 k Ω) Common in mode A / B	
Resolution	Less than 0.2 %	
Duty cycle	100 %	
Ambient temperature	-20 to 55 °C	
Space heater	1 W	
Manual operation	Direct operation of actuator by loosening lock screw	
Enclosure	Equivalent to IP65 (IEC 60529)	
Housing material	Aluminum alloy die cast + Polycarbonate resin cover	
Terminal block	For bare wire 0.2 to 1.5 mm ² (AWG 26 to 16) Ground terminal: M3	
Conduct port	G3/8 Cable gland (for $\Phi 5$ to 10.5 mm cable)	

*1 Change by DIP switch. (Standard \rightarrow Mode B)**WIRING**

The diagram illustrates the internal wiring and components of the PAX actuator. It shows the terminal block connections for power, input signal, and indication signal. The control board features several trimmers for signal calibration and a DIP switch for mode selection. A potentiometer is used to adjust the operation range.

Setting with DIP switch
Mode A / B is selected simply by setting the mode change DIP switch located on built-in control board.

Mode A

Mode B

Note)

- Input signal circuit is non-isolated. Do not connect DC (-) wire to other DC (-) common.
- Do not adjust operating angle of a valve (OPEN/SHUT trimmer). Please contact us if you need to adjust operating angle.

ELECTRIC ACTUATOR SPECIFICATIONS

3 way valve: SHUT / Position①, OPEN / Position②

OPTIONAL PARTS

Specifications		Code No.	PAX	Remarks
Aluminum alloy motor cover		AK	○	
Flexible cable (Approx. 300 mm long)		C1	○	
Operation	SHUT by decreased signal ↔ OPEN by Increased signal	Nil	○	Mode A
	SHUT by increased signal ↔ OPEN by decreased signal	J	○	Mode B

DIMENSION

PAX (050)

PAX (120)

Parts name

1	Body	4	Control board	7	Drive shaft
2	Motor cover	5	Terminal block	8	Rubber packing
3	Motor	6	Potentiometer		

ADJUSTMENT (PAX)

① Dead band

Turn the trimmer clockwise for wide the dead band as necessary.
It is useful to prevent the hunting reaction of actuator.


*Each trimmer on a built-in control board.

② Operating range

Do not adjust operating angle of a valve (OPEN, SHUT trimmer).
Please contact us if you need to adjust operating angle.

③ Operating speed (Speed control)

No adjustment required. (ZERO, SPAN trimmer)

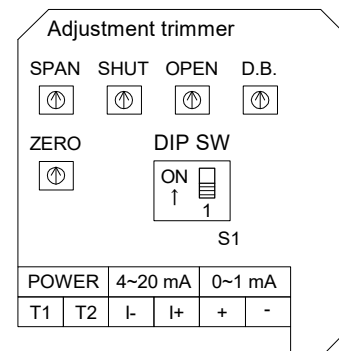


ELECTRIC ACTUATOR SPECIFICATIONS

3 way valve: SHUT / Position①, OPEN / Position②

ACR type

Actuator type	ACR-030-2
Voltage	100 to 220 V AC $\pm 10\%$ 50/60 Hz
Rated torque [N·m]	3
Operation time [s]	When power supply on → less than 12 When power supply shut off → less than 6
Power consumption (Max) [VA]	30
Motor	DC motor
Overload protection	Thermistor
Method of operation	Operation by power ON / OFF
Operation	Power OFF : SHUT ↔ Power ON : OPEN (Standard) Power ON : SHUT ↔ Power OFF : OPEN (Option: 45)
Built-in power supply	Electric double layer capacitor
Duty cycle	20 % 15 min.
Ambient temperature	-20 to 50 °C
Manual operation	Direct operation of output shaft
Enclosure	Equivalent to IP65 (IEC 60529)
Housing material	Aluminum alloy die cast + Polycarbonate resin cover
Terminal block	For bare wire 0.14 to 1.5 mm ² (AWG 26 to 16) Ground terminal: M3
Conduct port	G3/8 Cable gland (for $\Phi 5$ to 10.5 mm cable)

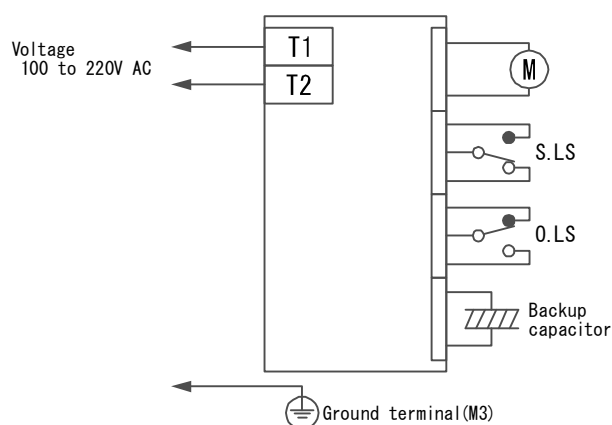WIRING

Note) This actuator uses a switching power supply. After turning on the power, inrush current flows. Selecting the switch to afford.

INSTALLATION, OPERATION & MAINTENANCE INSTRUCTIONS

HANDLING & STORAGE

①HANDLING

Do not drop or throw the product as it may break.

②STORAGE

- Store away from dust, moisture and direct sunlight. If possible, store in the original package.
- Do not remove a dust proof cap until the piping.


③CHECKING

- Check the product code, power supply, and voltage before installation.
- Make sure that the bolts are not loose.
- The DIP switch should be set up before the power is turned on. Do not touch unnecessary switches. (PAX)

INSTALLATION


①PRECAUTIONS

- Flush the pipeline carefully before installing the valve. Foreign particles, such as sand or pieces of welding electrode, will damage the ball and seats.
- For valves with specified flow direction (AE, EG, SH, MV) or with ST / SC option, check the arrows on the product before piping.
- When the flow path is subjected to a high pressure from arrow, it may leak slightly to the low pressure port. (TE, EL, TV, ST, SL)



②PIPING

- Using a pipe with too long a thread will damage the valve.
- If sealing tape or sealant gets inside the valve, the valve seat leaks or malfunctions.
- To prevent the valve from being damaged by stress, always hang a wrench on the end of the valve on the side where the pipe is to be connected when screwing in the pipe or when unscrewing it after correcting the angle (Fig a and b) and do not use a pipe wrench on the valve. Do not apply force to the actuator when working on the piping. (Fig. c)

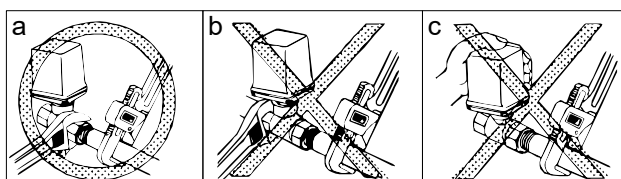

- Refer to the recommended tightening torque table and do not apply excessive torque.

Valve size [mm]	Torque [N·m]
008 to 010	15 to 20
015	25 to 35
020	40 to 50
025	50 to 60
032	60 to 80
040	75 to 85
050	90 to 110

③ENVIRONMENT

- Do not install in place where corrosive gas is present or where vibration is heavy (0.5 G or more).
- When radiant heat causes the surface temperature of the control unit to exceed 55 °C (more than 50 °C for ACR only), provide an appropriate shielding plate.
- If there is a possibility that the fluid and drive part freeze, please take measures to prevent freezing.

④POSITIONING

Should be positioned through 90° upward from horizontal. Provide space around the product to allow manual operation, inspection and replacement work.

Margin required around the actuator for maintenance

AM (030 / 070)	DM2 (030)	More than 65 mm
AM AH1 DM PAX ACR		More than 90 mm

⑤OTHER NOTES

Until the wiring is completed there must be no condensation or flooding in the interior of the actuator, after piping. Protective caps on the cable gland are not waterproof.

WIRING

- Do not wiring outdoors on a rainy day.
- Check the power supply and voltage. Connect the signal as shown in the wiring diagram.
- Do not connect unnecessarily terminal.
- Use suitable flexible cable (Φ5 to 10.5 mm). Lock and seal the cable completely to prevent condensation inside the actuator.
- Built-in terminal block can clamp up to 1.5 mm² in diameter without using solderless terminal.
- Allow proper cable slack for maintenance.
- Actuator should be electrically grounded. Use the terminal marked (≡) inside the actuator.

PREVENT DEW CONDENSATION

- When installing the cover after wiring, perform the bolt by the temporary tightening procedure and the permanent tightening procedure to tightly and securely tighten the rubber packing so that water does not enter from the outside.
- Tighten the cable gland nut so that there is no leakage from the wire entrance.

INSTALLATION, OPERATION & MAINTENANCE INSTRUCTIONS**CONTROL****①AM1, AH1**

Control switch should be prepared one by one for actuator. Do not operate two or more actuator from one switch. It might malfunction.

②AM2

- Two or more actuators can be operated with one control switch.
- When using control switch with current leakage (more than 1 mA) such as TRIAC or relay with CR, it can cause malfunction.
- When wiring is long distance or handling a weak current signal, it may be affected by induced voltage or noise. In this case, please use countermeasures such as using a shielded wire, separating it from other power cables.

③DC POWER SUPPLY (DM0, DM2)

- It is usable with a battery and full-wave rectification circuit.
- Consider an inrush current of motor.
(It is 1.5 to 3 times of consumed current.)
- They may cause malfunction with decreasing voltage by the long wiring.
- Do not use power supply that require more than 1 second with rise and fall time.

④USE OF OPEN / SHUT SIGNALS (AM, AH, DM)

Use signals within the capacity of output signal rating.

⑤ACR

- Inrush current flows when the switching power supply is turned on. Use a fuse, relay or switch with sufficient capacity.
- It may be affected by induced voltage or noise. Please use countermeasures such as using a shielded wire, separating it from other power cables.
(When a power supply is off, the terminal block should make the induced voltage less than 10 V.)

⑥PAX

- Use shielded wire for signal wiring where high level noise is generated or when the wiring distance is long.
- Control with a 1 to 5 V input signal becomes an input resistance 250 Ω . Provide a voltage that can safely 20 mA or more than.
- Check whether the MODE change DIP SW on a circuit board substrate is set up correctly.
When wiring, if wiring of a signal is mistaken, it will not operate correctly. Contact us when you use two valve or more by one controller or indicator.
- Input signal circuit is non-isolated.
Do not connect DC (-) wire to other DC (-) common.
- The input signal and operation mode are set as follows. (Factory shipped)

Input signal	4 to 20 mA or 1 to 5 V
Operation mode	Mode A
Operation	SHUT by decreased signal OPEN by increased signal

OPERATION**①TESTING**

- Make sure that power supply voltage is correct.
- Check operating position and wiring. (AM, AH, DM)
- During trial operation, check that valve movement and output signal are correct. (PAX)

②DUTY CYCLE (AM, AH, DM, ACR)

Confirm that the operation frequency is within the specified duty cycle.

Use beyond the load time rate range will affect product life. Also, it may cause burnout.

Duty cycle is a value that regulates the opening / closing frequency of the actuator. The meaning of 20 % 15 minutes for Duty cycle is that 3 minutes (20 % of 15 minutes) operation is possible. The calculated value obtained by dividing 3 minutes by the operation time is the number of times of operation within 15 minutes.

③CONFIRM THE OPERATING CONDITION (PAX)

- Adjust fluid condition, controller setting, sensor etc. so that stable control is achieved.
- When used in an unstable control state, the life of the actuator and the valve will be shortened.
- The desired control state is stable at the target value. Adjust the PID setting value of the controller when overshooting the target value greatly, when not converging for a long time or hunting operation. Also, when the time delay is large, please consider the sensor position.

④ATTENTION

- Be sure to set the DIP-SW before turning on the power supply. (PAX)
- Keep power supplied for built-in space heater to prevent condensation inside actuator.
(AM, AH, DM, PAX)
- Do not touch the moving parts of actuator in operation.
- Do not insert a reverse signal during operation.
It may shorten the life of product. (AM, AH, DM, ACR)
- Never put anything on the actuator or make it into a foothold.

INSTALLATION, OPERATION & MAINTENANCE INSTRUCTIONS

MANUAL OPERATION

①PRECAUTIONS

- Manual operation should be a temporary operation.
- Be sure to turn off the power before manual operation.

②ACR

If it is not left after power supply cut off for 6 hours, it will operate with capacitor charge voltage. Make sure that the following procedure in case of emergency.

- 1) Put an allen wrench into the hold on drive shaft and turn slowly.
- 2) Internal limit switch gets used from a switch setting cam, then the motor of actuator will operate and it hold in the position.
- 3) The capacitor discharge in about 1 minute, perform manual operation.

③NOTE



For manual operation, do not give more than the rated torque and make at a slow rate. Actuator might be damaged if excessive force is added.

MAINTENANCE

- To prevent electric shock, be sure to turn off the power when removing the actuator cover.
- Do the routine maintenance at least once in half a year.

Inspection items

- Confirm operation of opening and closing.
- Confirm that an actuator is not hot excessively.
- Confirm existence of abnormal noise and vibration during operation.
- Confirm whether screws are loose or not.
- Confirm that water or condensation no remains in the actuator.
- Turn off the power and check if the valve operates normally with built-in capacitor. (ACR)
- Confirm the fluid temperature or pressure.
- Confirm the leak from valve stem.

AM PAX	AH DM ACR
 <p>Actuator can be easily removed from the valve by loosening 3 lock screws, and that allows direct operation of the valve. After operation, be sure to put back the actuator to the original position and lock.</p>	 <p>Put an allen wrench (5 mm) or a lever (Φ5.7) into the hole on drive shaft and turn slowly. Manual lever is optional.</p>

INSTALLATION, OPERATION & MAINTENANCE INSTRUCTIONS**TROUBLE SHOOTING**

Problem	Cause	Solution
Actuator does not move.	Faulty wiring.	Correct the wiring.
	No voltage is coming.	Check the voltage.
	Incorrect voltage.	When it's burned out by excess voltage, replace the actuator.
	Connection or wiring is not correct. PAX	Correct the miswiring and misconnection. Be careful not to mistake the plus and minus of wiring.
	Short the circuit, contact failure.	Review wires and connection.
	Motor is too old.	Replace the actuator.
Operation is unstable.	Excess surge or voltage was applied.	Replace the actuator.
	Rainwater entered the actuator.	
	Switch leakage current is large. AM2	Current leakage should be less than 1 mA.
Operation is unstable. PAX	Added high harmonics noise from an inverter.	Attachment a filter for each inverter maker option.
	Effect of high level noise.	Use the shielded wire and ground the wiring. Separate signal wire from power line.
Stop in the mid position. (Input signal's 1 to 5 V.) PAX	Signal voltage source capacity shortage.	Use a voltage source that can be made to flow more than 20 mA. Please contact us.
Stop in the mid position.	Continuous irregular stop will shorten the motor life and wear the gear. Turn off the power and check. AM1 AM2 AH1-030	

Problem	Cause	Solution
Stop in the mid position.	<ul style="list-style-type: none"> • Biting of valve seat. • The scale has adhered to the valve ball. 	Remove a foreign object.
		Clean or replace valve parts. MS MV
	Overload protector runs because of over-torque.	Turn off the power for about 3 minutes to remove a heat from motor protection circuit. AM1 AM2 AH1 DM2 DM0 ACR
		Motor protection circuit returns by the signal of operation of an opposite direction. Turn on the power again. PAX
	Capacitor is too old. ACR	Replace the actuator.
Leakage from valve body	<ul style="list-style-type: none"> • Valve cap get loose. • Valve body is damaged. 	Replace the valve.
Leakage from valve seat	Seat is worn or damaged.	Replace the valve.
		Replace the valve seat. MS MV
Leakage from valve stem	Stem packing is worn or distorted.	Replace the valve.
		Replace the packing. MS MV

For more information contact
NIPPON VALVE CONTROLS, INC. for consultation.